

Water Quality Report for Irrigation

EFMA Primary Network

Lab results			Water Quality for Irrigation (annex XVI, DL n.º 236/98)	
Responsible Laboratory: Cesab (Bulletin n.º 237/22)				
Parameters	Units	Results	Conformity	
Alkalinity	mg/L CaCO ₃	125		
Ammonium	mg/L NH ₄	0,136		
Nitrogen Kjeldahl	mg/L N	0,74		
Total Nitrogen	mg/L N	0,78		
Bicarbonates	mg/L CO ₃ H-	153	(a)	
Boron	mg/L B	0,0229	●	
Calcium	mg/L Ca	38,1		
Chloride	mg/L Cl	56,2	●	
Total Hardness	mg/L CaCO ₃	152		
Total Iron (b)	mg/L Fe	0,071	●	
Phosphates	mg/L P ₂ O ₅	0,01		
Total Phosphorus	mg/L P	0,02		
Magnesium	mg/L Mg	18,1		
Manganese	mg/L Mn	0,0192	●	
Nitrates	mg/L NO ₃	<LQ	0,3	●
Nitrites	mg/L NO ₂	0,01		
Potassium	mg/L K	5,65		
Ratio of Sodium Absorption (SAR)		1,21	●	
Ratio of Sodium Absorption adjusted (SARaj)		1,26		
Sodium	mg/L Na	36,2		
Total Dissolved Solids (TDS)	mg/L	284	●	
Total Suspended Solids (TSS)	mg/L	<LQ	3	●
Sulphates	mg/L CO ₄	43,5	●	
Total Coliforms	NPM/100 mL	210		
Fecal Coliforms	NPM/100 mL	194	●	

Note: With the exception of the SARaj parameter, test to determine the remaining parameters are included in the range of laboratory accreditation.

Field Results (Determined with a multiparameter probe)			Water Quality for Irrigation (annex XVI, DL n.º 236/98)
Parameters	Units	Results	
Temperature	°C	11,4	
pH	Escala Sorensen	8,33	●
Conductivity	µS/cm	494	●

- Lower than the VMR (Maximum Value Recommended).
- Higher than VMR and below the VMA (Maximum Permitted Value).
- Higher than VMR. For this parameter is not defined one VMA.
- Higher than the VMA.

(a) The maximum value recommended in the Integrated Production Standards, for most crops, is 90 mg / L.


(b) The VMA in Annex XVI of the Decree-Law n.º 236/98 refers to the dissolved iron (5 mg/L Fe).

Sampling Data: 25/01/2022

Sampling Place: Loureiro

Benefited areas:

The Loureiro reservoir constitutes the water source of the Monte Novo, Loureiro-Alvito and Évora irrigation perimeters.

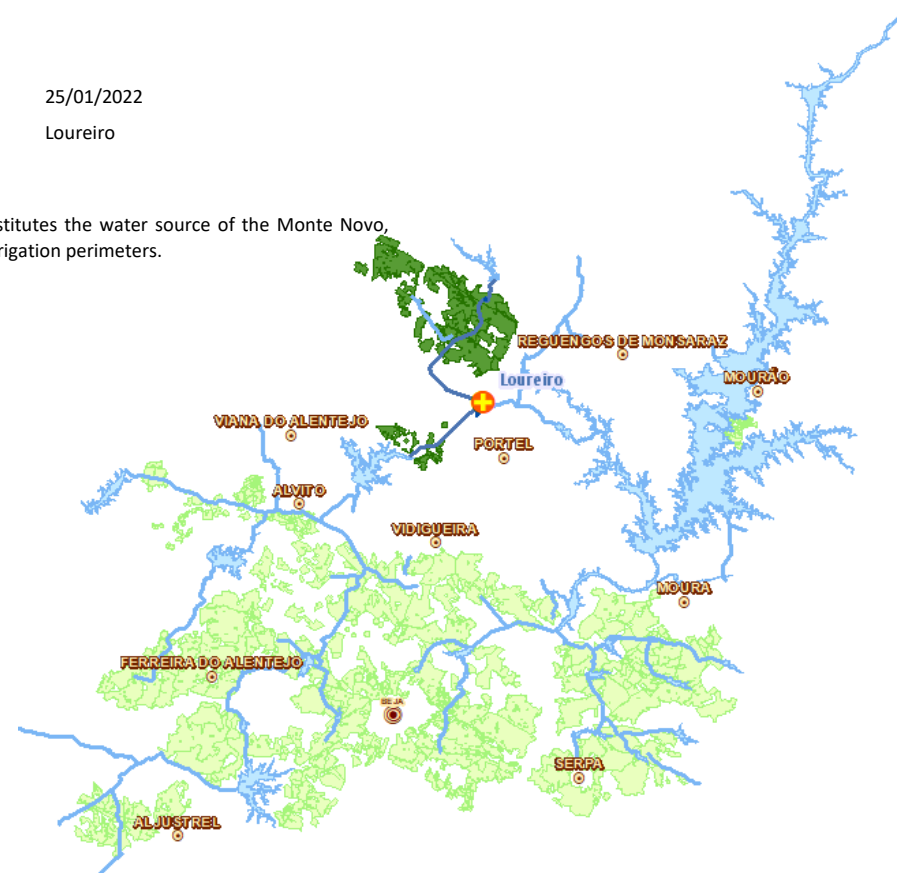

Comments:

The result of fecal coliforms exceeds the Maximum Recommended Value for irrigation water (VMR: 100 NMP/100mL). A maximum allowed value (VMA) is not defined for this parameter. The results of faecal coliforms in Loureiro tend to be below the legal limit for irrigation water, with the result in the November 2021 campaign being 1 NMP/100 mL. The main problem associated with the presence of fecal coliforms in the irrigation water is related to the irrigation of crops for direct consumption.

The bicarbonate values exceed the maximum value recommended in the Integrated Production Standards. High concentrations of bicarbonates can affect crop yields, making it difficult to absorb some mineral nutrients.

The results of the remaining elements are within the range of expected values for this typology of water bodies.

In the document "Water Quality - Complementary Information", EDIA recommends some general measures to reduce the concentration of salts in the water bodies.