

## Water Quality Report for Irrigation EFMA Primary Network

Lab results Responsible Laboratory: ALS Life Sciences Portugal, S.A.	(Bulletin nº 254024/2023)			Water Quality for Irrigation (annex XVI, DL n.º 236/98)
Parameters	Units	Results		Conformity
Alkalinity	mg/L CaCO3		127	
Ammonium	mg/L NH4	C	),057	
Nitrogen Kjeldahl	mg/L N		0,9	
Total Nitrogen	mg/L N		0,6	
Bicarbonates	mg/L CO3H-		142	(a)
Boron	mg/L B	0,	0304	
Calcium	mg/L Ca		38,1	
Chloride	mg/L Cl		58,4	
Total Hardness	mg/L CaCO3		169	
Total Iron (b)	mg/L Fe	C	),022	
Phosphates	mg/L P2O5	C	),066	
Total Phosphorus	mg/L P	C	),029	
Magnesium	mg/L Mg		18	
Manganese	mg/L Mn	0,	0162	
Nitrates	mg/L NO3	<lq< td=""><td>2</td><td></td></lq<>	2	
Nitrites	mg/L NO2	<lq< td=""><td>0,01</td><td></td></lq<>	0,01	
Potassium	mg/L K		6,6	
Ratio of Sodium Absorption (SAR)		1	L,093	
Ratio of Sodium Absorption adjusted (SARaj)		1	l,122	
Sodium	mg/L Na		32,7	
Total Dissolved Solids (TDS)	mg/L		314	
Total Suspended Solids (TSS)	mg/L	<lq< td=""><td>3</td><td></td></lq<>	3	
Sulphates	mg/L CO4		42,5	
Total Coliforms	NMP/100 mL		0	
Fecal Coliforms	NMP/100 mL		0	


## Sampling Data: Sampling Place:

15/06/2023

Alqueva-Captação (near the capture of Álamos)

## **Benefited** areas:

The capture of Álamos adds water to the entire Alqueva subsystem, which includes the Álamos, Loureiro, Reservatório R4, Monte Novo, Alvito, Odivelas, Pisão, Cinco Reis, Penedrão, Roxo and Vale do Gaio reservoirs.

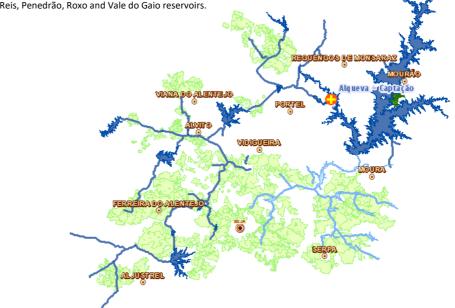

Note: With the exception of the SARaj parameter, test to determine the remaining parameters are included in the range of laboratory accreditation.

Field Results (Determined with a multiparameter probe)				Water Quality for Irrigation (annex XVI, DL n.º 236/98)
	Parameters	Units	Results	Conformity
Temperature		°C	24,4	
pН		Escala Sorensen	8,90	<u> </u>
Conductivity		μS/cm	512	

- Lower than the VMR (Maximum Value Recommended)
- Higher than VMR and below the VMA (Maximum Permitted Value)
- Higher than VMR. For this parameter is not defined one VMA.
- Higher than the VMA

(a) The maximum value recommended in the Integrated Production Standards, for most crops, is 90 mg / L.
(b) The VMA in Annex XVI of the Decree-Law nº 236/98 refers to the dissolved iron (5 mg/L Fe).

Dep. de Ambiente e Ordenamento do Território



The pH result exceeds the Recommended Maximum Value range for water quality for irrigation (VMR: [6.5-8.4]). This may be due to an increase in the biological activity of algae. High pH values can affect the plant's ability to absorb nutrients and promote the precipitation of iron, calcium, magnesium and phosphate ions, which may promote the clogging of drip irrigation systems. The bicarbonates results exceed the maximum recommended in the Integrated Production Standards. High concentrations of bicarbonates can affect crop yields, making it difficult to absorb some mineral nutrients.

The results of the other parameters are within the ranges of normal values for this type of water bodies.

In the document "Water Quality - Complementary Information", EDIA recommends some general measures to reduce the concentration of salts in the water bodies.





